



REVISIONS				
REV	ZONE	DESCRIPTION	DATE	APPROVED
01	ALL	MOUNT SOLENOID DIRECTLY TO PISTON END.	01/30/18	R. LAM

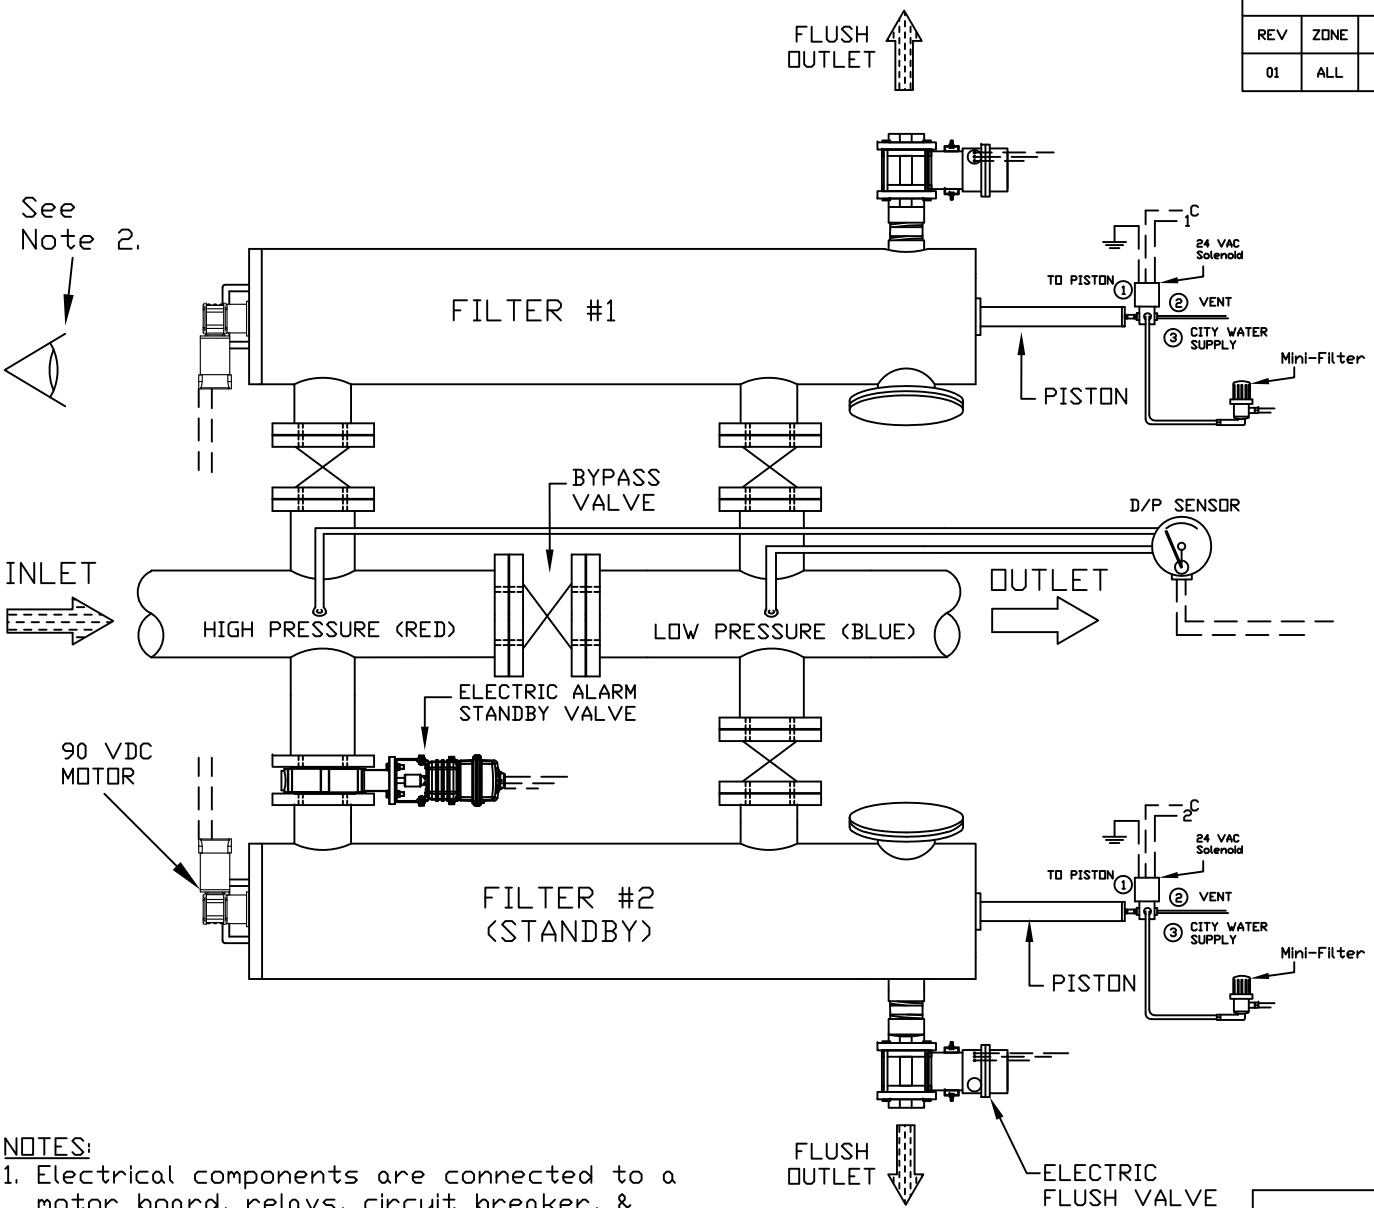

# LPF-GB7 ELECTRIC CONTROLLER

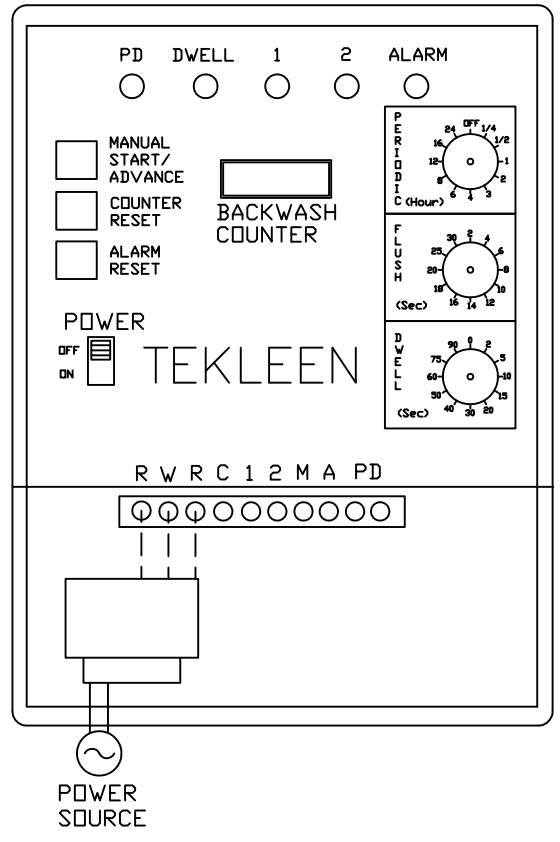

- NOTES:**
- Electrical components are connected to a motor board, relays, circuit breaker, & transformer that are located inside electric controller box. See connection drawing for detailed wiring of components to controller.
  - Motor must rotate counter clockwise from viewpoint for filters that contain a screen with area less than 5.0 sq. ft. (I.E. models LPF2-SP, 2-XLP, 3-LP, 3-SP, 4-LPE, 4-P & 6-P). Motor must rotate clockwise for all other filters.

-----	Electrical Connection
====	Hydraulic Connection
○	Junction
∪	No Junction

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES		AUTOMATIC FILTERS, INC. 2672 S. LA CIENEGA BLVD. LOS ANGELES, CA 90034 (310) 839-2828 FAX (310) 839-6878	
DECIMALS .XX ± .05 .XXX ± .01	ANGULAR ± 0.5 DEG.	TITLE 2 LPF FILTERS IN PARALLEL W/ GB7 ELECTRIC CONTROLLER, ELECTRIC FLUSH VALVES, SOLENOID VENT FOR PISTONS, & ELECTRIC ALARM STANDBY VALVE	
DRAWN S. PERKINSON	DATE 02/19/2014	SIZE A	DWG NO. WIRE-2LPFGB7-EFV-EBV-LAY-02
CHECKED	DESIGN FOR:	NOT TO SCALE	REV 01
			SHEET 1 OF 1